


NEW TO OLD WORK RADIUS TIE-IN

NTS

NOTES:

1. CONCRETE MIX SHALL USE NATURAL SAND UNLESS NOTED AS COLORED CONCRETE ON PLANS. MANUFACTURED SAND IS NOT ACCEPTABLE.
2. CONTROL JOINTS ARE TOOLED OR SAW CUT WITH 'V' CHASER TO 1/4 SLAB DEPTH.
3. FINISH IS MEDIUM BROOMED USING MEDIUM STIFFNESS, ANGLED NYLON RESIN CONCRETE BRUSH SUCH AS MARION 16 THOUSANDTH DIAMETER BRISTLE (ORANGE) OR EQUAL.
4. EXPANSION JOINTS ARE 3/4" ASPHALT SATURATED FIBER JOINT OR APPROVED EQUAL; 1/2" BELOW CONCRETE SURFACE.
5. EXPANSION JOINT SEALANT SHALL BE SONNEBORN SONOLASTIC NP1 OR EQUAL APPLIED APPROX. 1/2" THICK OVER FIBER JOINTS. COLOR TO GENERALLY MATCH FINISHED CONCRETE.
6. ADJACENT POURS TO BE DOWELED AT 3' O.C. WITH 3/4" X 2' SMOOTH BARS 2" CLEAR.

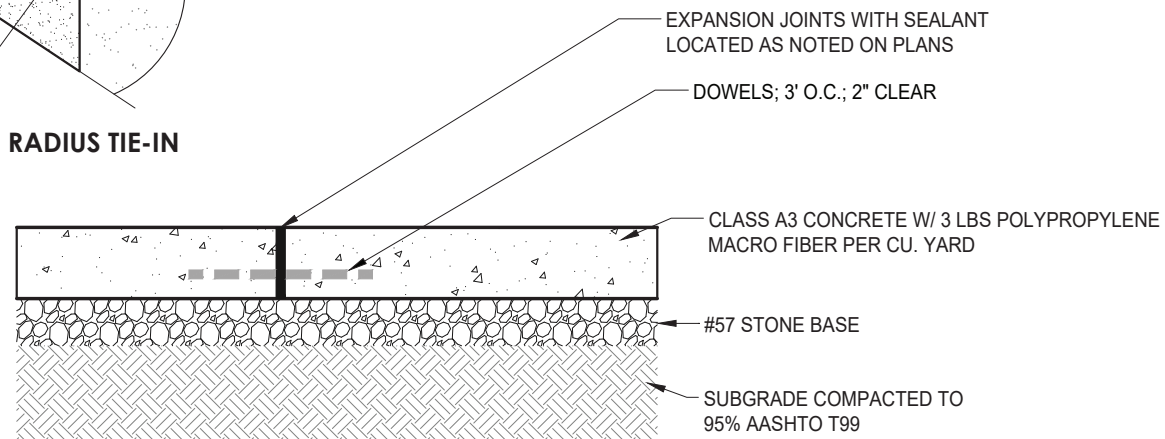

CONCRETE WALK/SLAB - FIBER REINFORCED

NOT TO SCALE