




## Generator General Installation Requirements

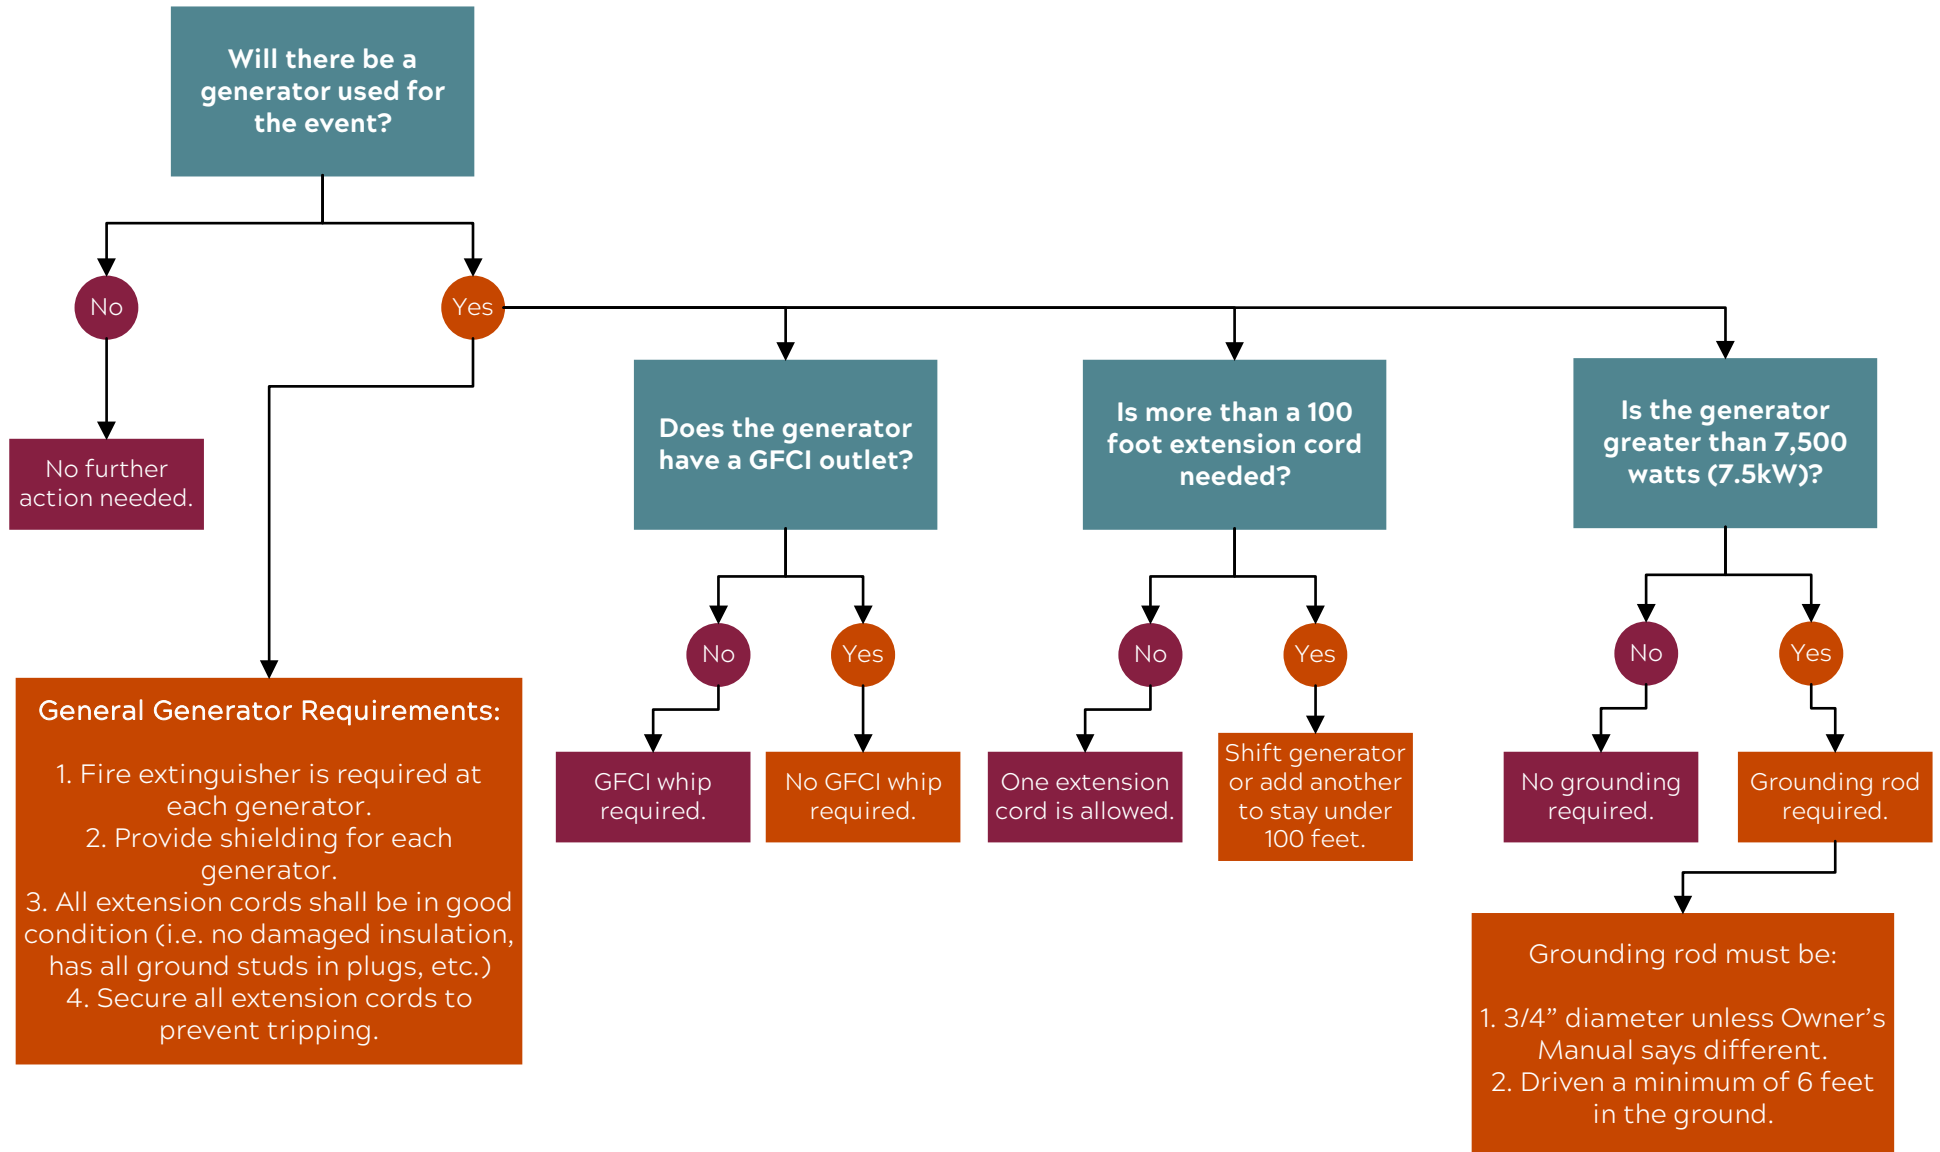

## Generators:

1. Generators (including light towers) shall be located a minimum of 10 feet from any stage, buildings, or other combustible materials, and 20 feet from tents, inflatables, or membrane structures.
2. Generators shall be isolated from the public by a physical guard, fence, or enclosure set up not less than 3 feet away from the generator.
3. Provide an approved portable fire extinguisher complying with section 906 for each generator in close proximity to the generator (including light towers).
4. Portable generators shall be grounded if they are over 7.5kW unless the owner's manual says differently. The grounding rod shall be per the manufacturer's installation instructions and the National Electric Code (NEC). If a grounding rod is required, there must be a minimum of 6 feet of embedment.
5. A ground fault circuit interrupter (GFCI) outlet or a GFCI whip shall be provided.
6. All extension cords shall not have any damaged insulation and shall have the ground stud in the plug connector.
7. Secure all extension cords to minimize tripping hazards.
8. Extension cords shall not be connected to each other (daisy-chained). Distribution boxes are required if more than one extension cord length is needed.